


*UIB operated a column of 8 thermocouples during IOPs, plus a portable station and soil measurements.



* Just aside, a Surface Energy Budget and a 8-m mast of U. of Bergen were deployed

*The thermocouples have been intercompared indoor at the UIB headquarters and the differences between them are less than 0.1 C. The data are ready to use now.

*The thermocouples were sampled at 10 Hz. In principle they cannot respond that fast, 3 Hz should be a normal cutoff frequency. Spectral analysis is pending.



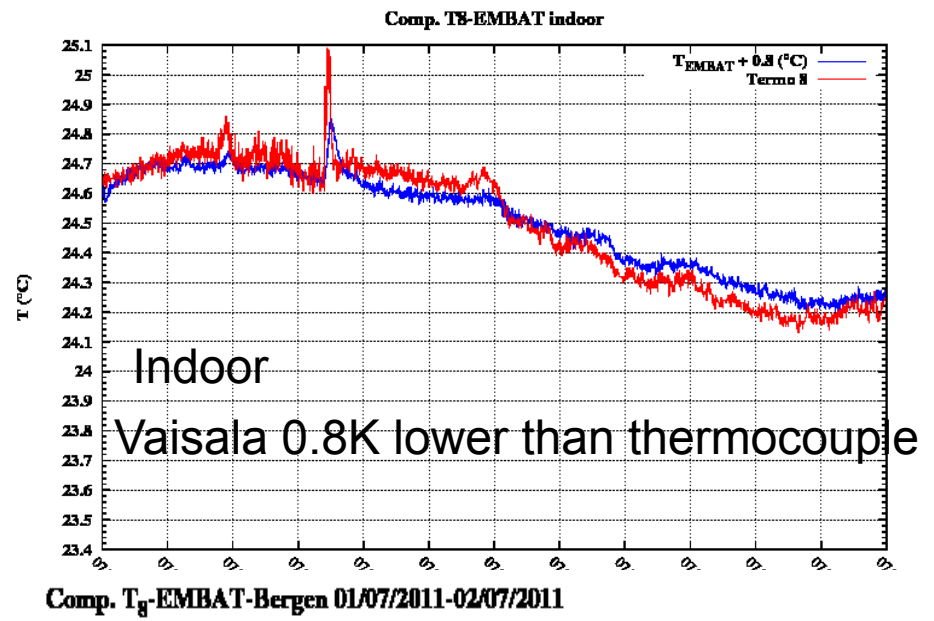


Altura dels termoparells

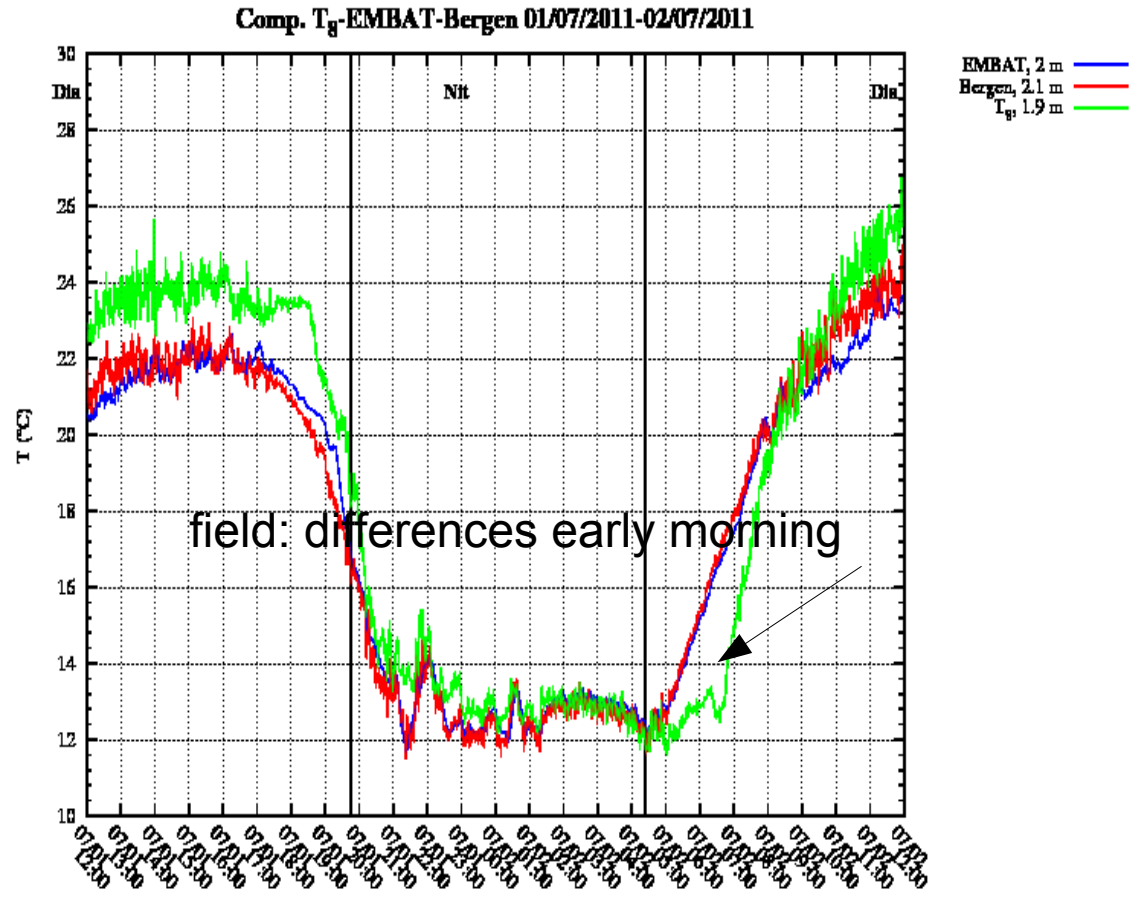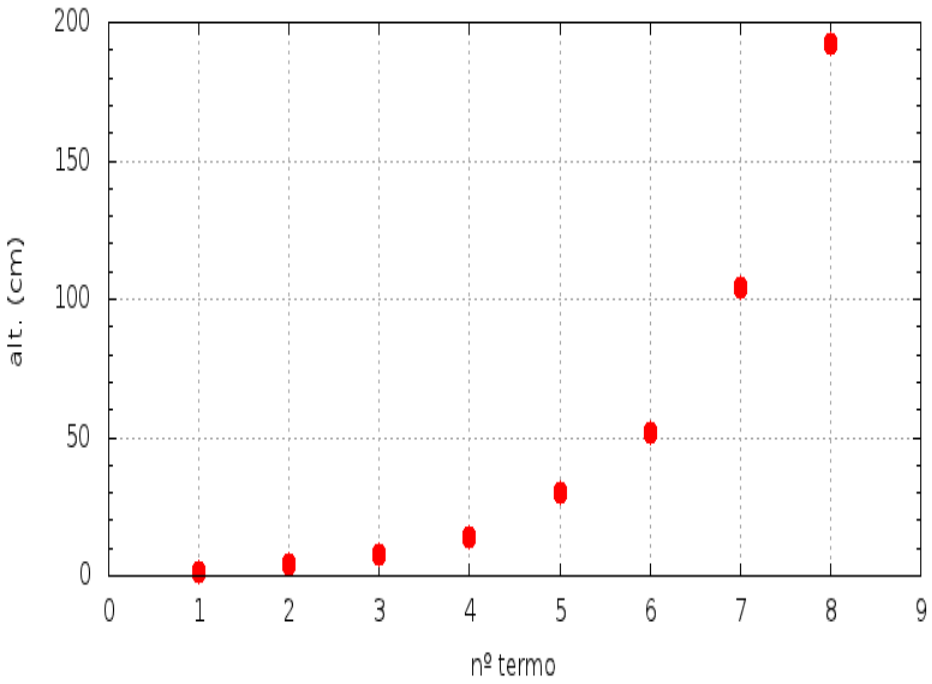

1/07/2011 - 02/07/2011

01/07/2011 a 02/07/2011

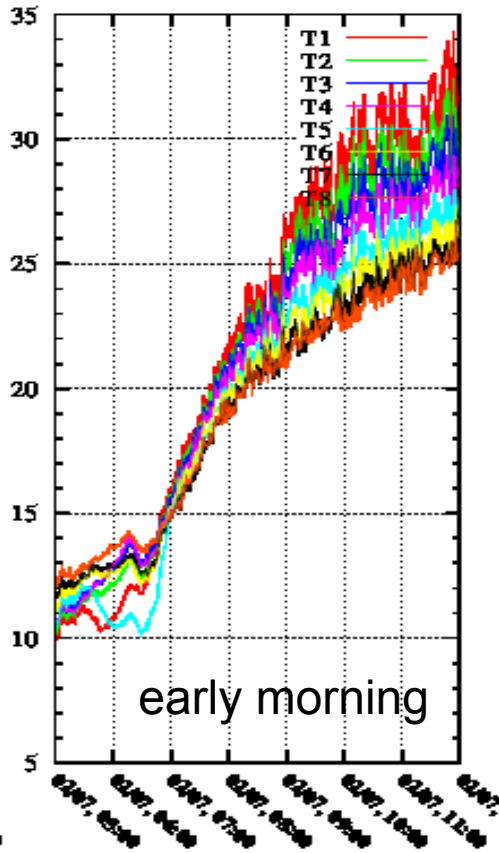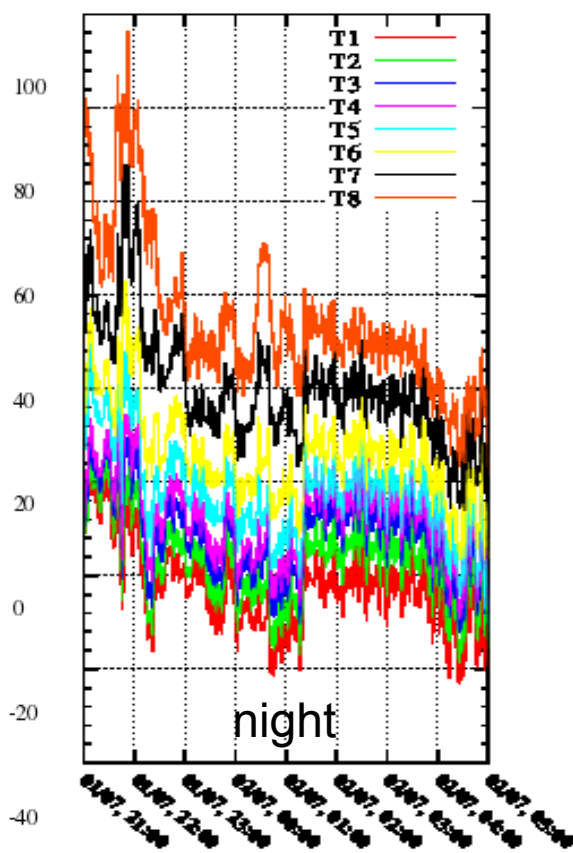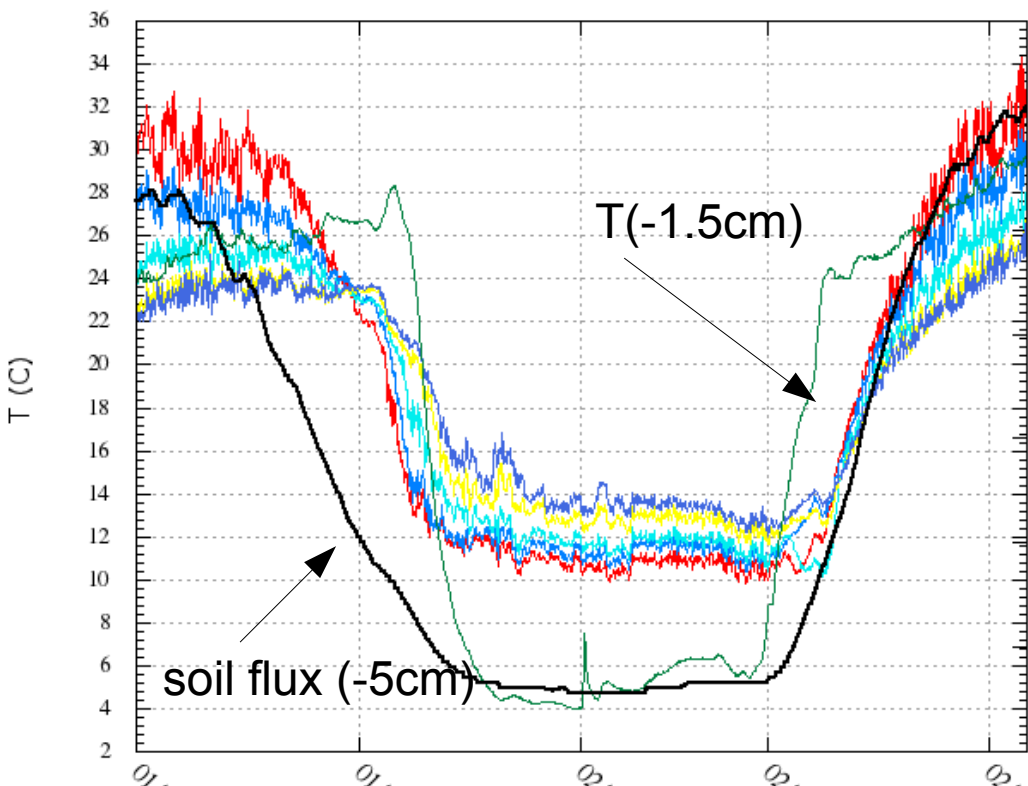

only TCs

TCs + Bergen + soil

